

Memo No:- 3275

Date:- 12/10/2023

Certificate
No: TC-8407

Subject : Physical / Chemical Examination Report of Water Sample

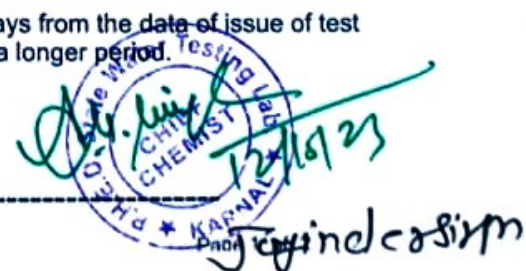
Sample ID/Classification : KNL/04175/10/2023 / Private	Sample Details	Date & Time
Sender : DOON INTERNATIONAL SCHOOL25846	Collected By	
Location : , Nr.CHIDAO MOR,V.P.O SHAHPUR,KARNAL	Collection Date	11/10/2023 at 15:32
Sample Description : Drinking Water	Received at lab	11/10/2023 at 15:38
Latitude / Longitude : 76.983788 / 29.688015	Analysis Start Date	11/10/2023
	Analysis End Date	12/10/2023
	Sample Quantity	1000ML

Test Result (As Per BIS 10500 :2012)

S.No.	Tested Parameter	Result	Requirement (Acceptable Limit)	Permissible Limit (In the Absence of Alternate Source)	Protocol Used
1	Total Dissolved Solids @ 180°C ± 2°C	310	500 mg/lt.	2000 mg/lt.	IS 3025 (Part-16) : 1984 (RA 2017)
2	Total Hardness as CaCo3	200	200 mg/lt.	600 mg/lt.	IS 3025 (Part-21) : 2009 (RA 2019)
3	Calcium as Ca	40	75 mg/lt.	200 mg/lt.	IS 3025 (Part-40) : 1991 (RA 2019)
4	Magnesium as Mg	24	30 mg/lt.	100 mg/lt.	IS 3025 (Part-46) : 1994 (RA 2019)
5	Iron as Fe	0.01	1.0 mg/lt.	1.0 mg/lt.	USEPA-8008:2017
6	Chloride as Cl	55	250 mg/lt.	1000 mg/lt.	IS 3025 (Part-32) : 1988 (RA 2019)
7	Sulphate as So4	25	200 mg/lt.	400 mg/lt.	USEPA-8051:2017
8	Fluoride as F	0.410	1.0 mg/lt.	1.5 mg/lt.	APHA 4500-F--C
9	Nitrate as No3	2.9	45 mg/lt.	45 mg/lt.	APHA 4500-NO3- D
10	pH @ 25°C	7.45	6.5 - 8.5	6.5 - 8.5	IS 3025 (Part-11) : 1983 (RA 2017)
11	Total Alkalinity	210	200 mg/lt.	600 mg/lt.	IS 3025 (Part-23) : 1986 (RA 2019)
12	Color	<5	5 Hazen Units	15 Hazen Units	IS 3025 (Part-4) : 1983 (RA 2017)
13	Odour	Agreeable	Agreeable	Agreeable	IS 3025 (Part-5) : 1984 (RA 2018)
14	Taste	Agreeable	Agreeable	Agreeable	IS 3025 (Part-8) : 1984 (RA 2017)
15	Turbidity	<1	1 NTU	5 NTU	IS 3025 (Part-10):1984 (RA 2017)

Remarks :-

- * The Results Given above are related to the sample as received and tested in PHED KARNAL Lab.
- * The test report can't be regenerated in whole or part there of without written permission of Competent Authority.
- * The test report can't be used for any publicity or any legal purpose.
- * Reliability of water sample sample lies with sender/collector of water sample.
- * To check the sample report online Scan the QR Code below.
- * The test samples meant for chemical analysis will be disposed off after 15 days from the date of issue of test report unless until specifically requested by the customer for retaining over a longer period.


 12/10/23
 Jeyindrasim

-----END OF TEST REPORT-----

Memo No:- 3275

Date:- 12/10/2023

Certificate
No: TC-8407

Subject : **Physical / Chemical Examination Report of Water Sample**



Sample analyzed by: *Jayinder Singh*

[Signature]
AMIT KUMAR, CHIEF CHEMIST 12/10/23
STATE WATER TESTING LABORATORY, KARNAL
email: chiefchemist@phedharyana.gov.in



-----END OF TEST REPORT-----